


# PLEASANTS COUNTY – PLEASANTS COUNTY MS FIRE SUPPRESSION SYSTEM AND ELECTRICAL/LIGHTING REPLACEMENT



The WV Fire Marshall stated the sprinkler heads and fire suppression system (installed in 1975) need to be replaced.

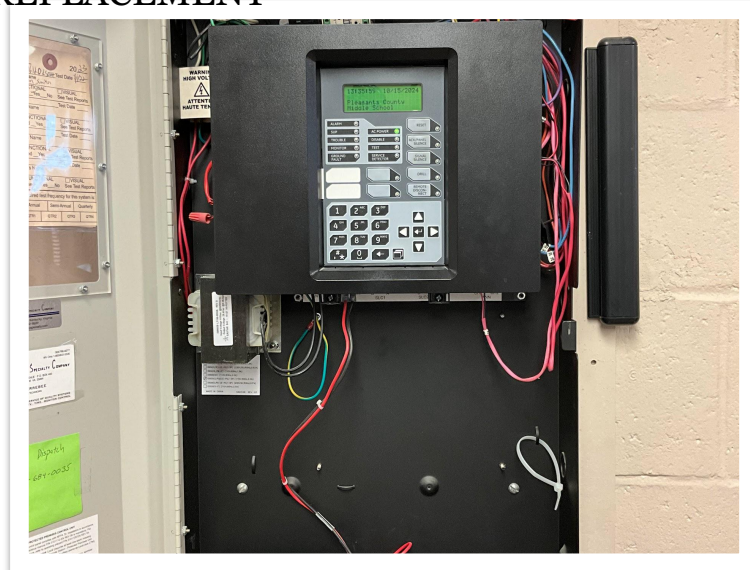

The fire suppression system's control panel frequently sends false alarms/codes, up to 30 times per day.



The school was originally designed with an open-classroom configuration. Electrical system components are all original, dating back to 1975.



Light switches for their respective classrooms are inconveniently located at the end of each corridor.